
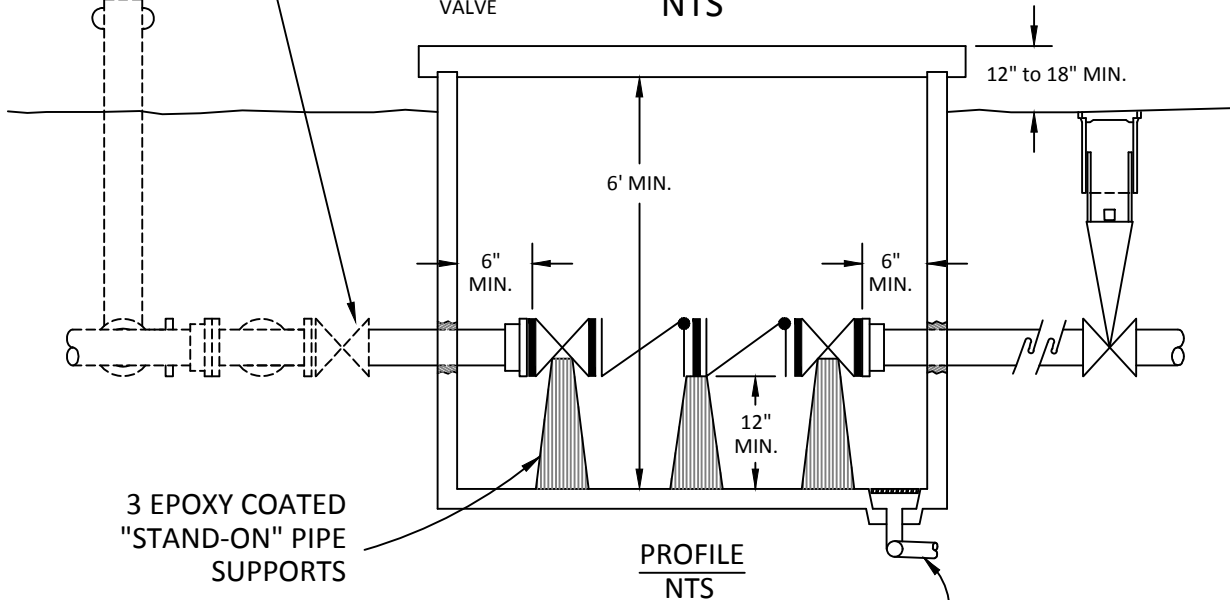


This Detail Drawing may not be altered or changed in any manner except by the City Engineer. It is the responsibility of the user to acquire the most current version.

*P.I.V. AND F.D.C. ARE NORMALLY FOR USE ON FIRE SPRINKLER SYSTEM LINES ONLY. SEE FIRE DEPT. FOR ADDITIONAL REQUIREMENTS.

SEE ADOPTED BUILDING AND FIRE CODES FOR FIRE SERVICE MAINS LOCATED OUTSIDE OF THE PUBLIC RIGHT-OF-WAY OR EASEMENTS.

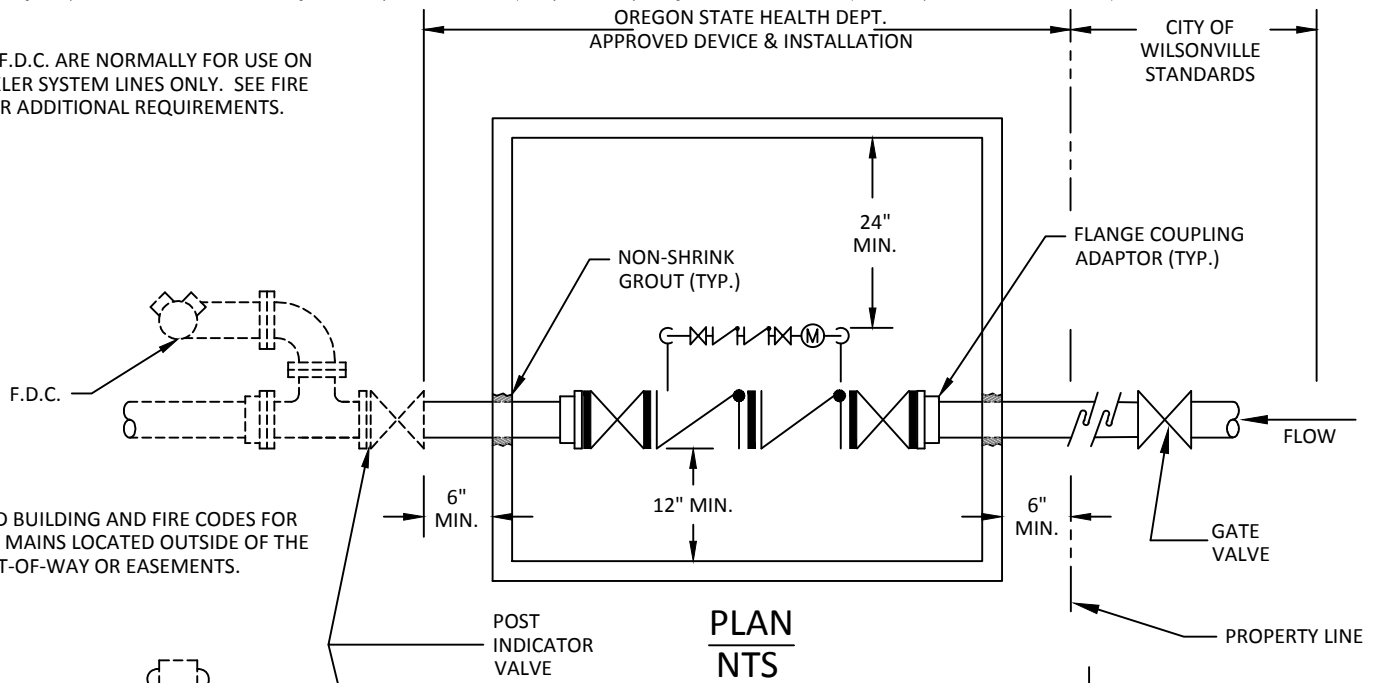

DRAIN TO DAYLIGHT OR STORM DRAIN SYSTEM, OR SUMP PUMP & HIGH WATER ALARM TO DAYLIGHT AS APPROVED BY WATER UTILITY

D.D.C. SIZE	UTILITY VAULT for DOUBLE DETECTOR CHECK DEVICE	
	VAULT	LID
3"	577-LA	LID 57-TL2-332P
4"	577-LA	LID 57-TL2-332P
6"	676-WA	LID 676-TL2-332P
8"	687-WA	LID 687-TL2-332P
10"	5106-WA	LID 5106-TL3-332P

