
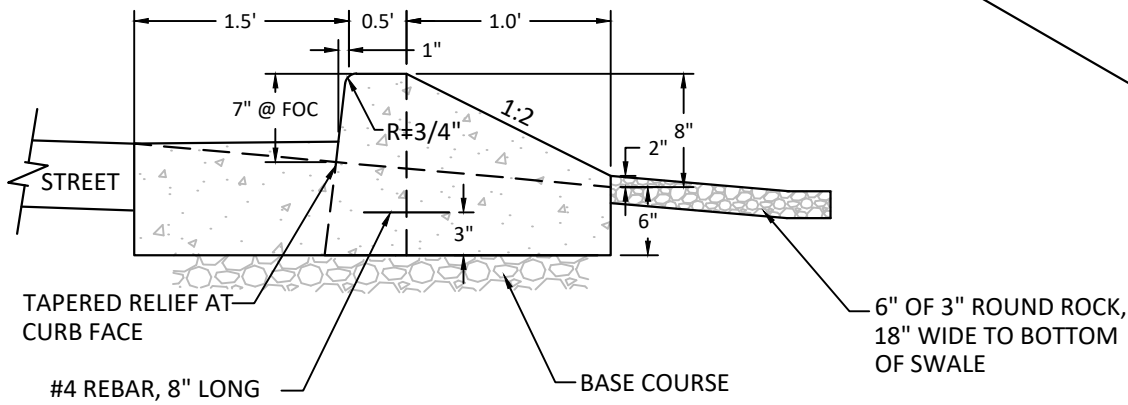


**SWALE INLET**  
NTS

**ISOMETRIC**  
NTS

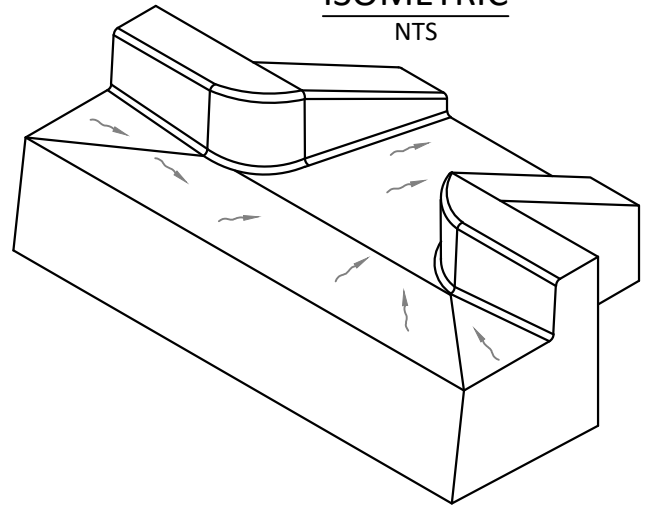

**SECTION A-A**  
NTS

Notes:

1. Concrete shall be commercial mix, minimum compressive strength of 3300 PSI at 28 days and incorporate micro-reinforcement "Fibermesh 300" or approved equal.
2. Base rock to be 3/4"-0 compacted to 95% of AASHTO T-180 and shall be to sub grade, street structure, or 4" in depth, whichever is greater.
3. Base course shall be thoroughly watered immediately prior to placement of concrete when the measured or forecasted ascending air temperature is 80 degrees or greater.

Swale Inlet

DRAWING NUMBER: ST-6012

DRAWN BY: SR

SCALE: N.T.S.

FILE NAME: ST-6012.dwg

APPROVED BY: PN

DATE: 05/16/19

CITY OF  
WILSONVILLE



PUBLIC WORKS STANDARDS